
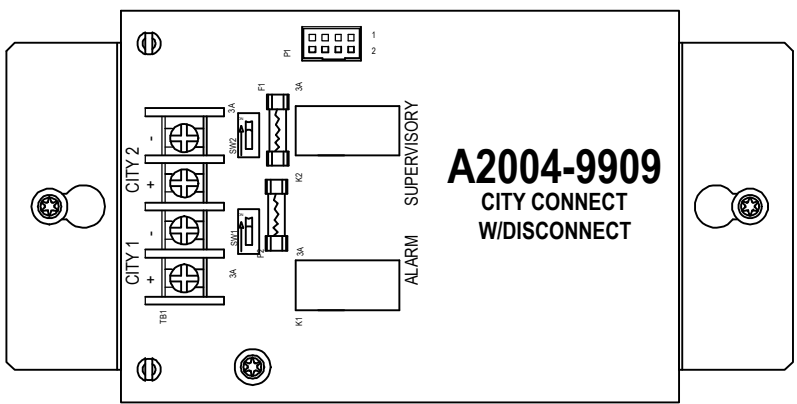


CONNECT TO
120VAC 60HZ

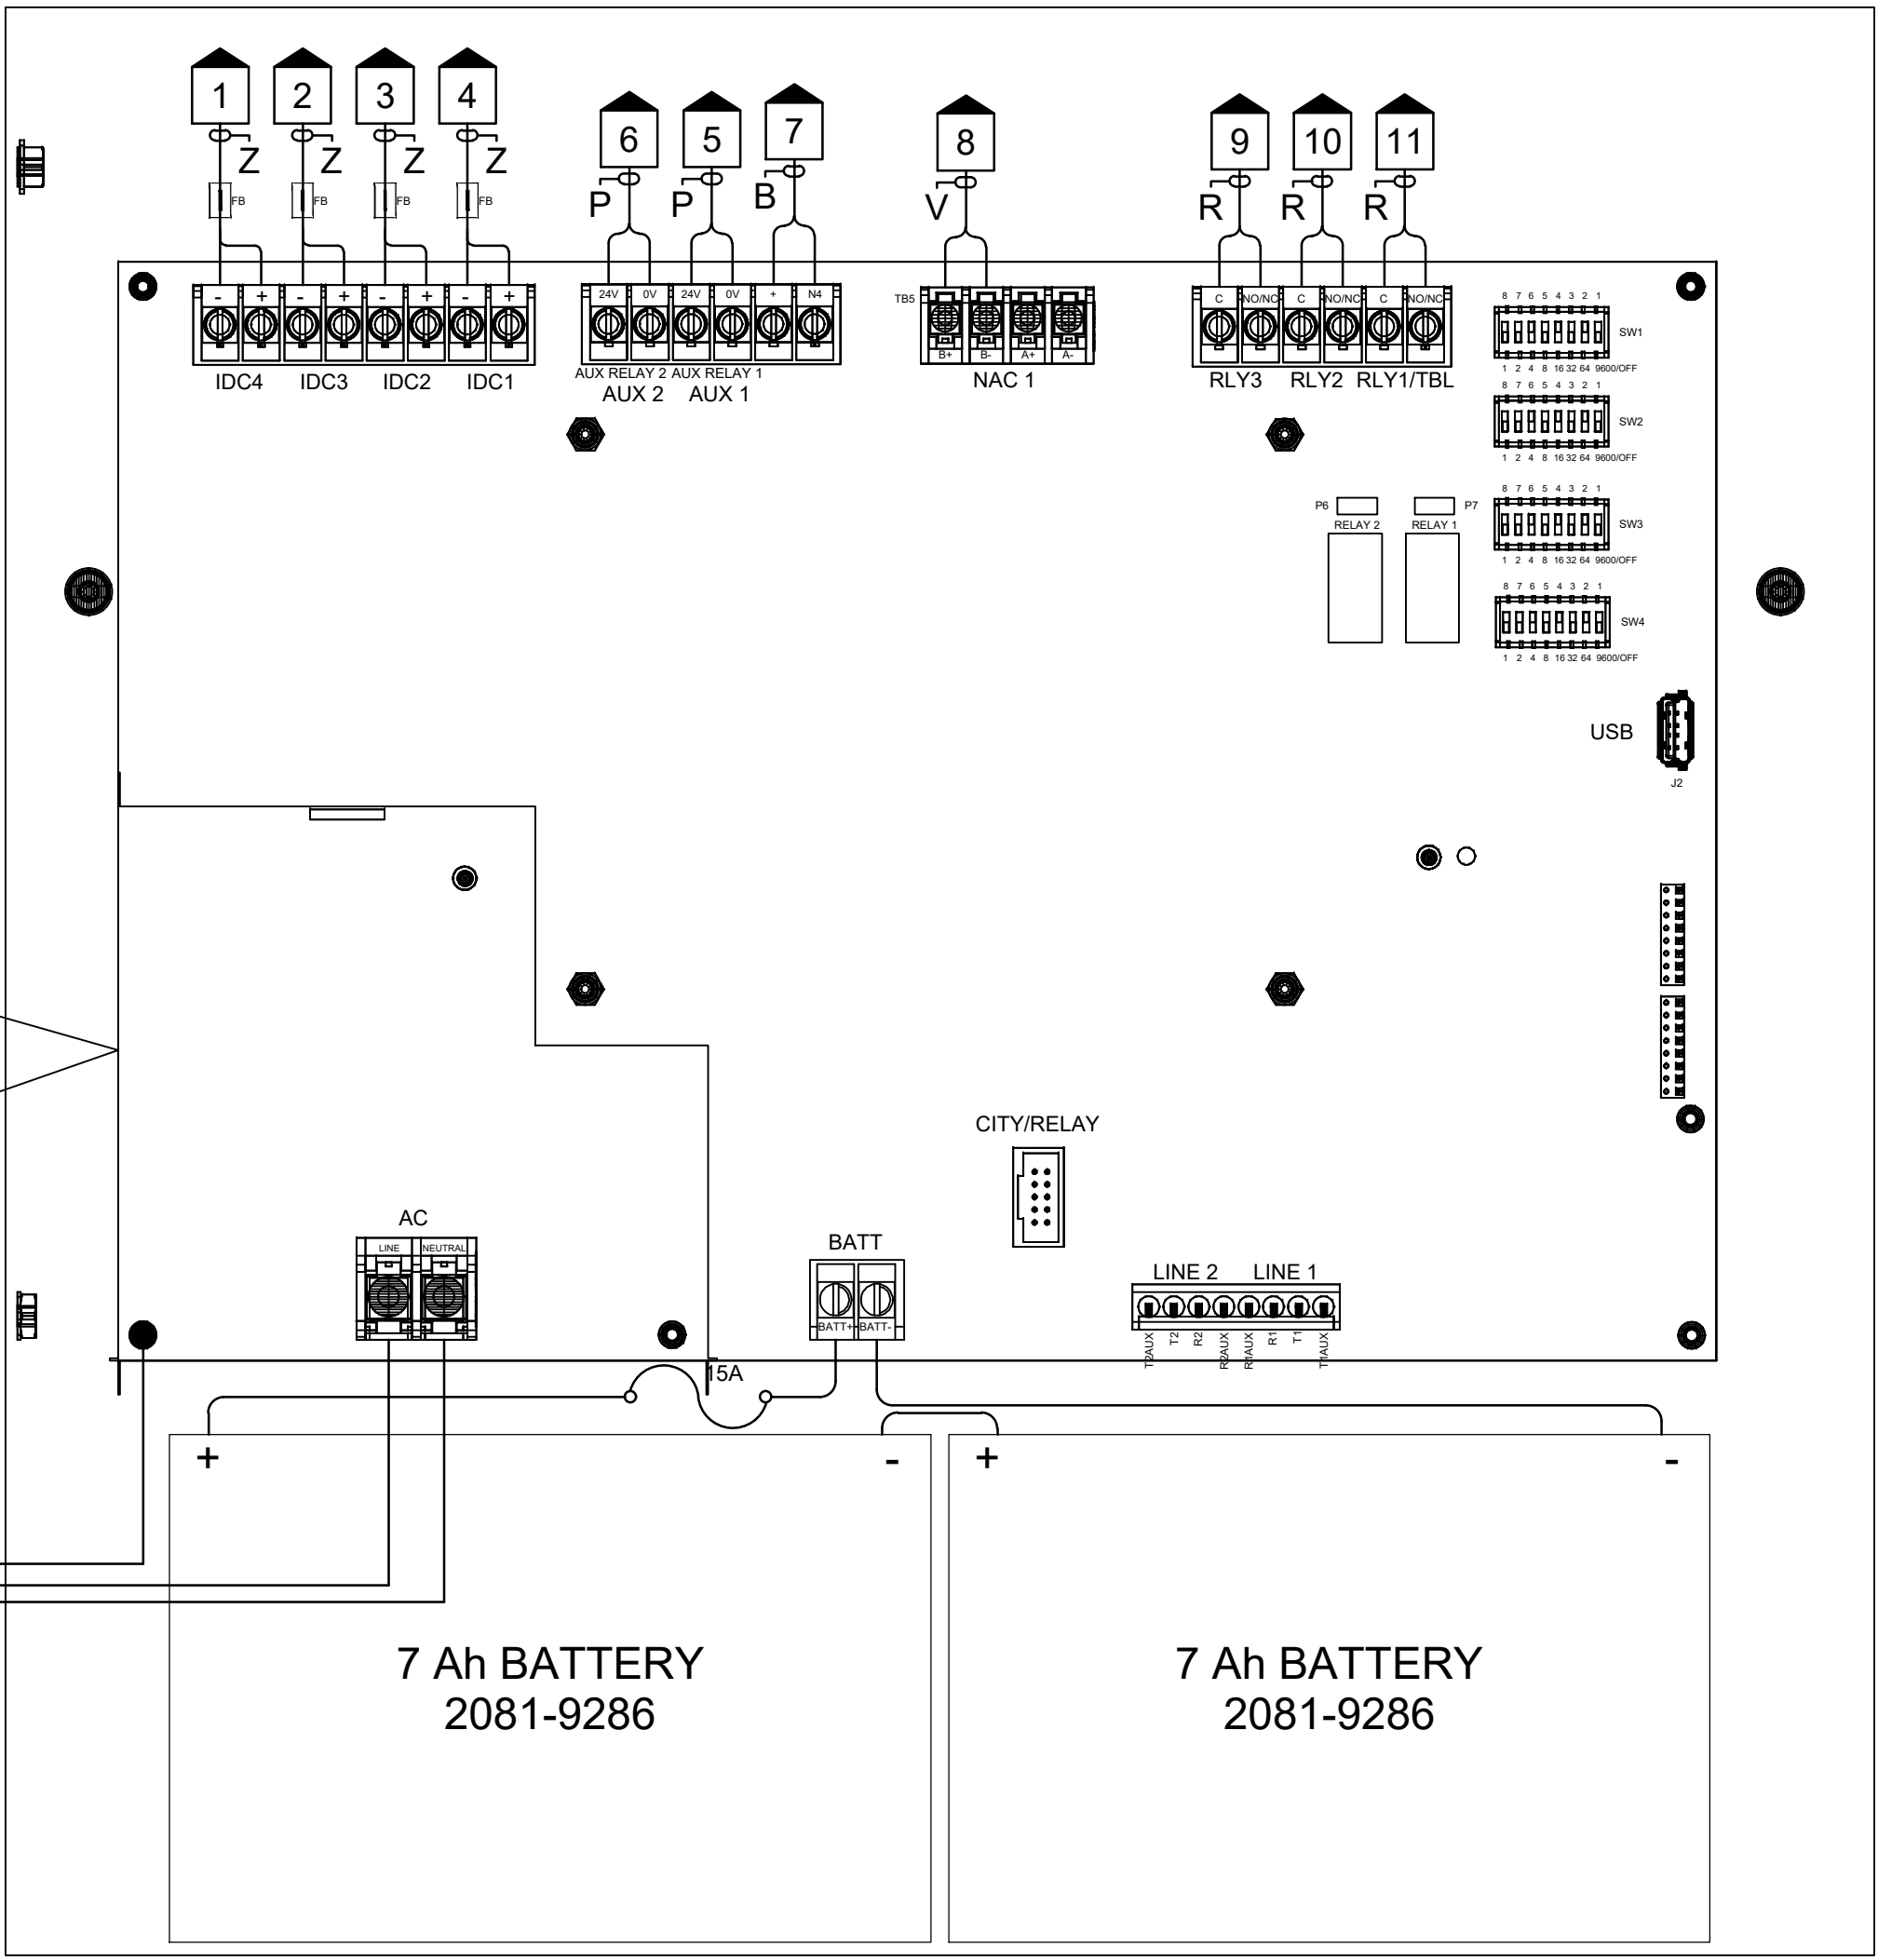

A004 TERMINATIONS

TERMINATION NUMBER			
	CIRCUIT LABEL	CKT DESCRIPTION	WIRE
1	IDC4	TO IDC DEVICES	Z
2	IDC3	TO IDC DEVICES	Z
3	IDC2	TO IDC DEVICES	Z
4	IDC1	TO IDC DEVICES	Z
5	AUX1	24 VDC TO REMOTE ANNUNCIATOR	P
6	AUX2	24 VDC TO CONVENTIONAL DETECTORS	P
7	RS485	RS485 TO REMOTE ANNUNCIATOR	B
8	NAC1	TO NAC DEVICES	V
9	RLY3	SUPERVISORY RELAY	R
10	RLY2	ALARM RELAY	R
11	RLY1	TROUBLE RELAY	R

PANEL_A004

PANEL_LOCATION_1
PANEL_LOCATION_2

SCALE: NTS

ISSUE LOG:		
MARK#1	DATE#1	DESCRIPTION#1
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-

DRAWN BY:	DRAWN BY:
DATE:	DATE:
JOB OR CASE #:	SALESFORCE CASE #: