


REMOTE ALARM INDICATOR / KEY SWITCH

AUTOCALL A2098-9806

##

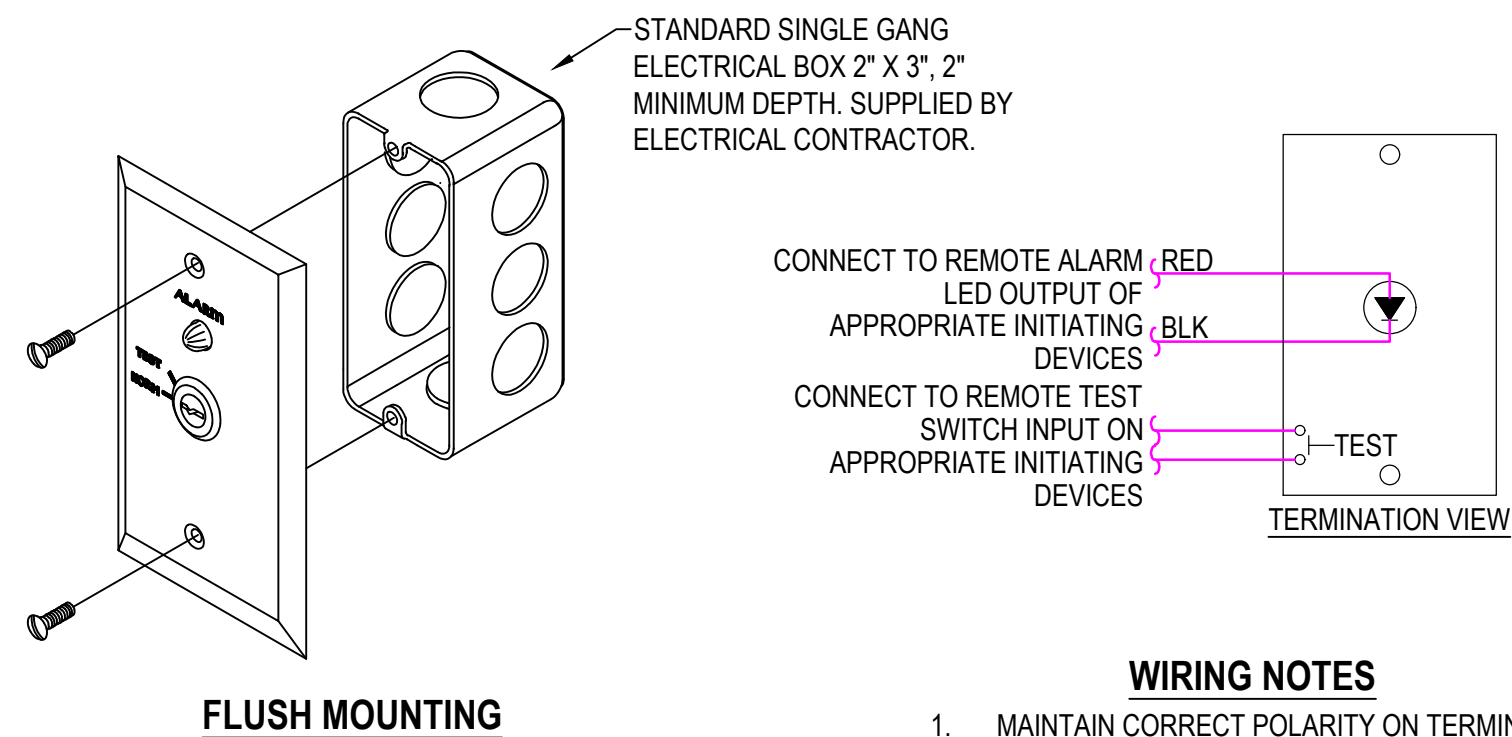

- WIRING NOTES**
- 1. MAINTAIN CORRECT POLARITY ON TERMINAL CONNECTIONS.
 - 2. ALWAYS CUT CONDUCTORS AND SECURE UNDER TERMINALS. NEVER LOOP WIRES UNDER TERMINALS.
 - 3. ONE INDICATOR MAY BE INSTALLED PER DETECTOR.

<div><div>Johnson Controls</div><div></div></div>	Owner	No.	Description	Date	Autocall_Remote Alarm Indicator Key Switch A2098-9806	
		01	For Review	07/14/2021	Project number	01
					Date 07/12/2021	
					Drawn by CV	
					Checked by MA	Scale NTS