


ISOLATED LOOP CIRCUIT PROTECTOR


AUTOCALL A2081-9027

##

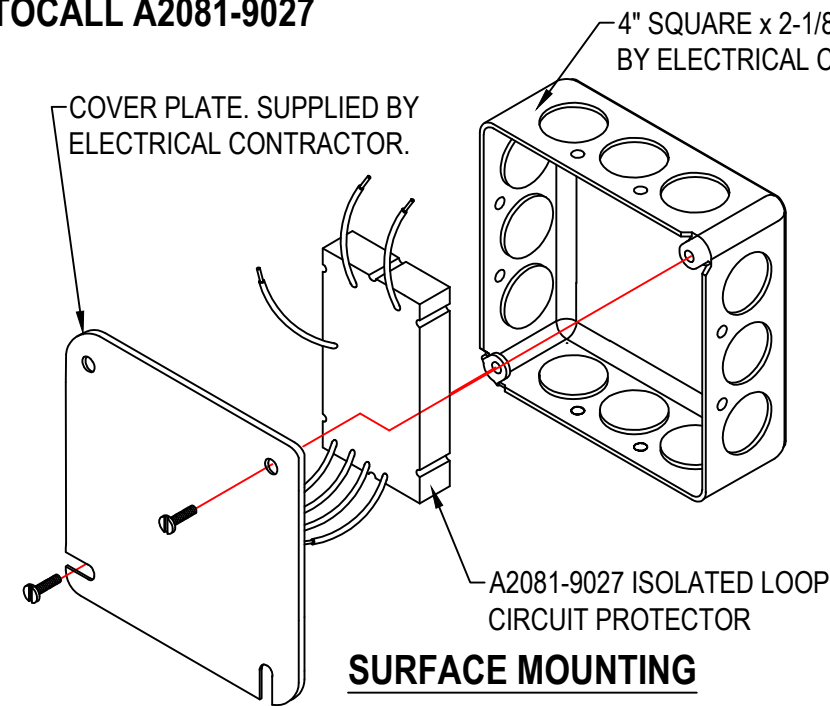

WIRING NOTES

1. MAINTAIN CORRECT POLARITY ON TERMINAL CONNECTIONS.
2. ALWAYS CUT CONDUCTORS AND SECURE UNDER TERMINALS. NEVER LOOP WIRES UNDER TERMINALS.
3. ALL LINES WHICH RUN EXTERNAL TO THE BUILDING MUST BE PROPERLY GROUNDED, TWISTED AND SHIELDED PAIRS.

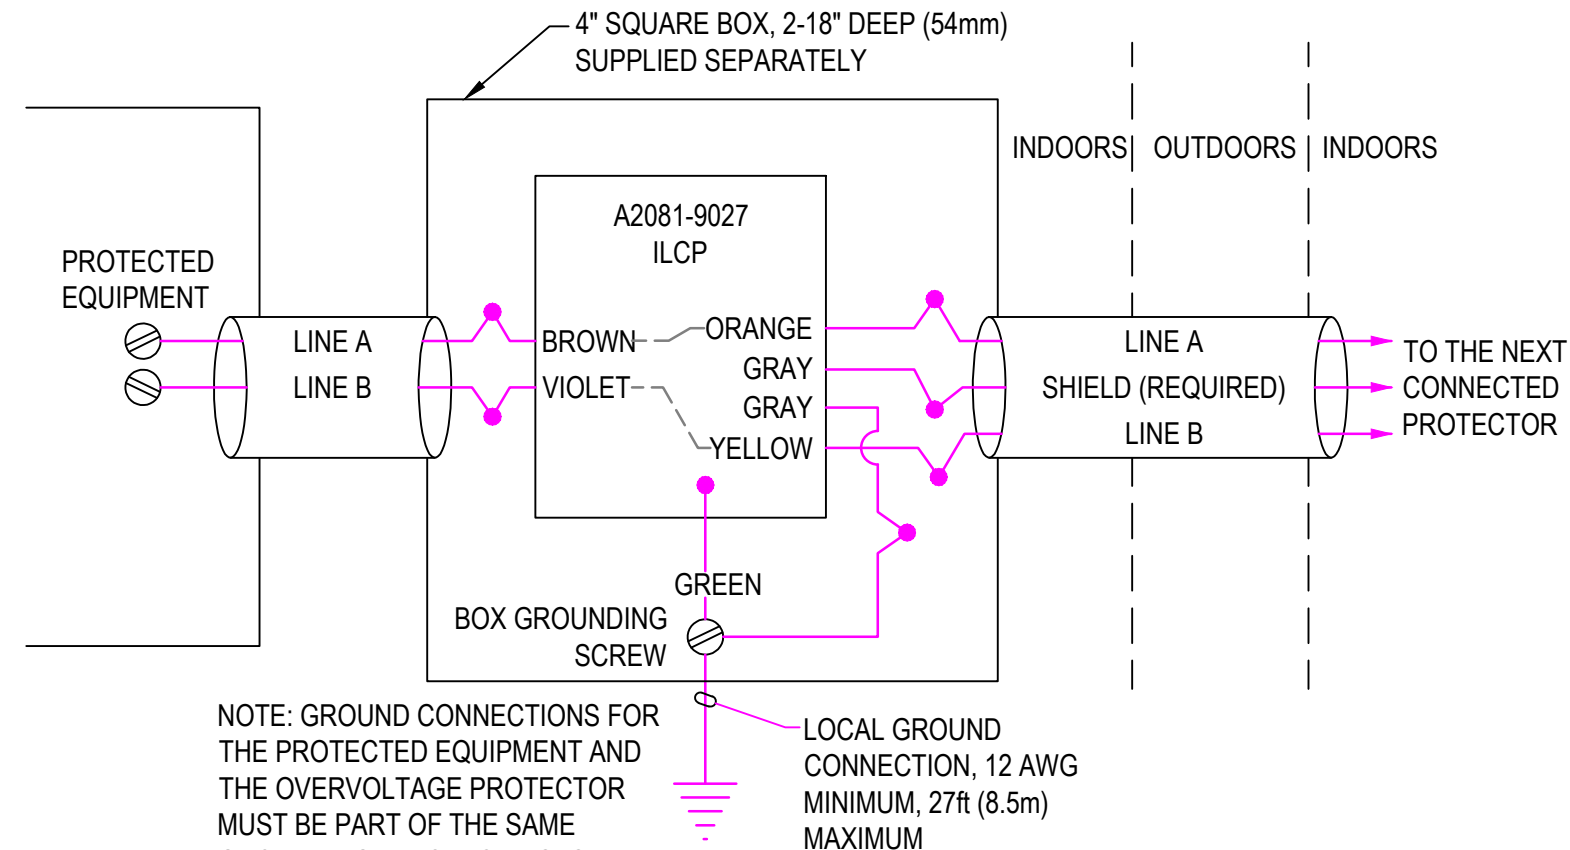

NOTE: GROUND CONNECTIONS FOR THE PROTECTED EQUIPMENT AND THE OVERVOLTAGE PROTECTOR MUST BE PART OF THE SAME GROUNDING ELECTRODE SYSTEM

FOR ADDITIONAL DETAILS SEE DATA SHEET A2081-0007 ON [HTTP://WWW.AUTOCALL.COM](http://www.autocall.com)



Owner

Project Name

No.	Description	Date
01	For Review	07/14/2021

Autocall Modules
A2081-9027

Project number

Date 07/12/2021

Drawn by CV

Checked by MA

01

Scale NTS