



ADDRESSABLE PULL STATIONS

AUTOCALL A4099 SERIES

##

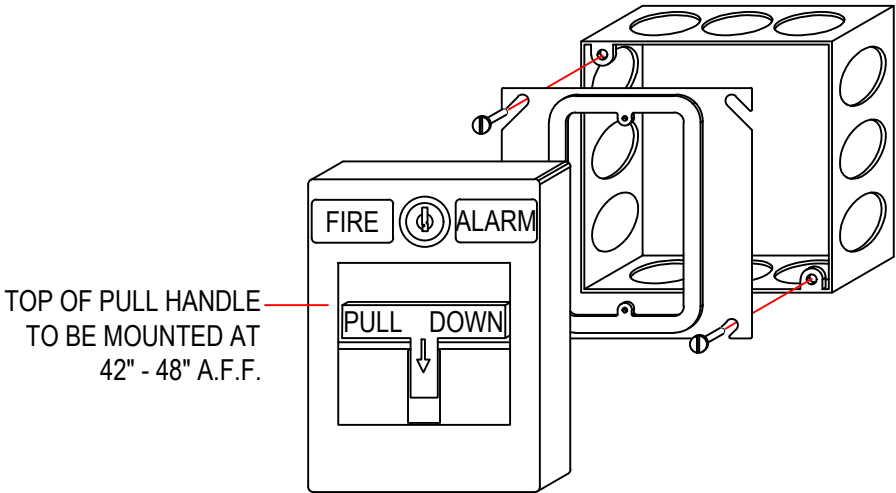


MOUNTING OPTION "B"

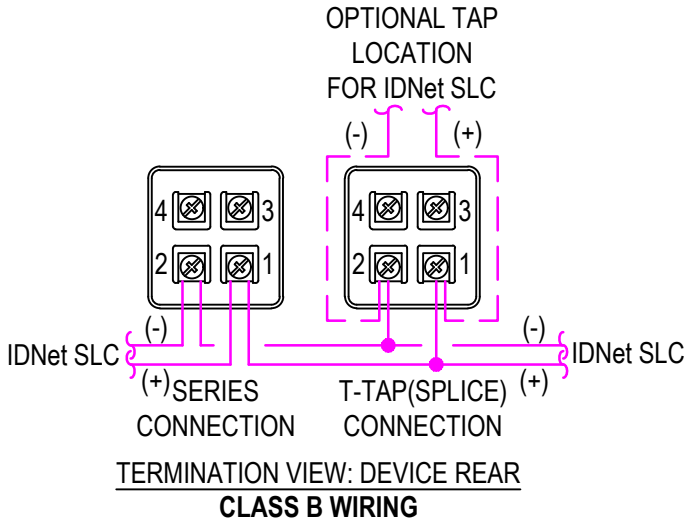

WIRING NOTES

1. MAINTAIN CORRECT POLARITY ON TERMINAL CONNECTIONS.
2. ALWAYS CUT CONDUCTORS AND SECURE UNDER TERMINALS. NEVER LOOP WIRES UNDER TERMINALS.
3. ANY WIRE SPLICES TO BE MADE BY LISTED AND AHJ APPROVED METHODS.

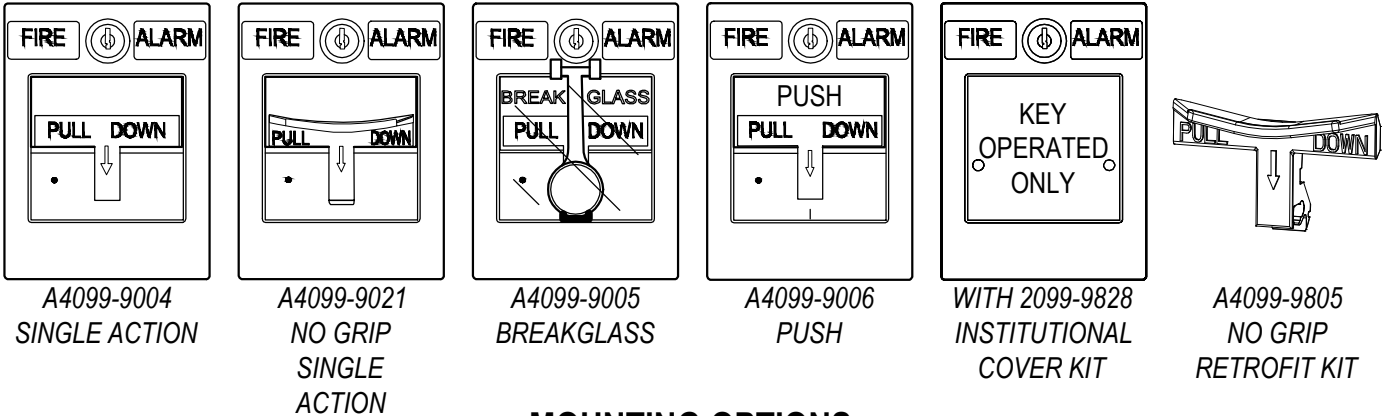

MOUNTING OPTIONS

OPTION ¹	DESCRIPTION	NOTE
A	SINGLE GANG BOX, 2-1/2" (64mm) DEEP	BY OTHERS
B	4" (102mm) SQUARE BOX, 2-1/8" DEEP (MIN) W/ SINGLE GANG COVER PLATE 3/4" (19mm) EXTENSION	BY OTHERS
C	AUTOCALL 2975-9022 - 5H x 3-7/8"W x 2-3/16"D (127mm x 98mm x 56mm)	ORDERED SEPARATELY
D	AUTOCALL 2975-9178 - 5-3/4"H x 3-7/8"W x 2-3/16"D (132mm x 102mm x 56mm)	ORDERED SEPARATELY

1. FOR ADDITIONAL MOUNTING OPTIONS, DOWNLOAD DATA SHEET A4099-0005 FROM [HTTP://WWW.AUTOCALL.COM](http://www.autocall.com)



Owner

Project Name

No.	Description	Date
01	For Review	07/14/2021

Autocall_4099 Series Addressable Pull Station

Project number

Date 07/12/2021

Drawn by CV

Checked by MA

01

Scale NTS