


TrueAlert ES ADDRESSABLE APPLIANCES


AUTOCALL A49SO SERIES WALL MOUNTED SPEAKER

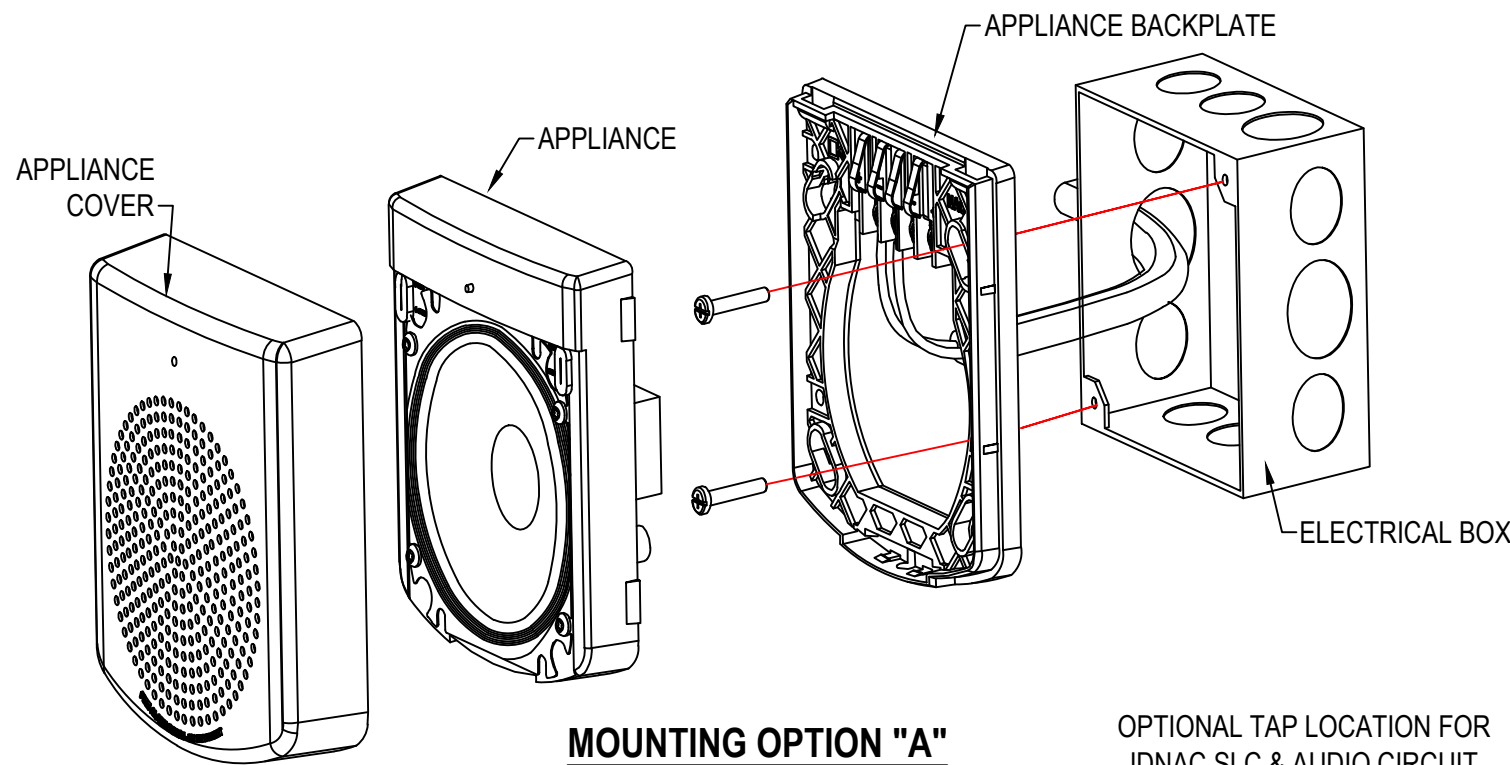

MOUNTING OPTION "A"

WIRING NOTES

1. MAINTAIN CORRECT POLARITY ON TERMINAL CONNECTIONS.
2. ALWAYS CUT CONDUCTORS AND SECURE UNDER TERMINALS. NEVER LOOP WIRES UNDER TERMINALS.
3. ANY WIRE SPLICES TO BE MADE BY LISTED AND AHJ APPROVED METHODS.

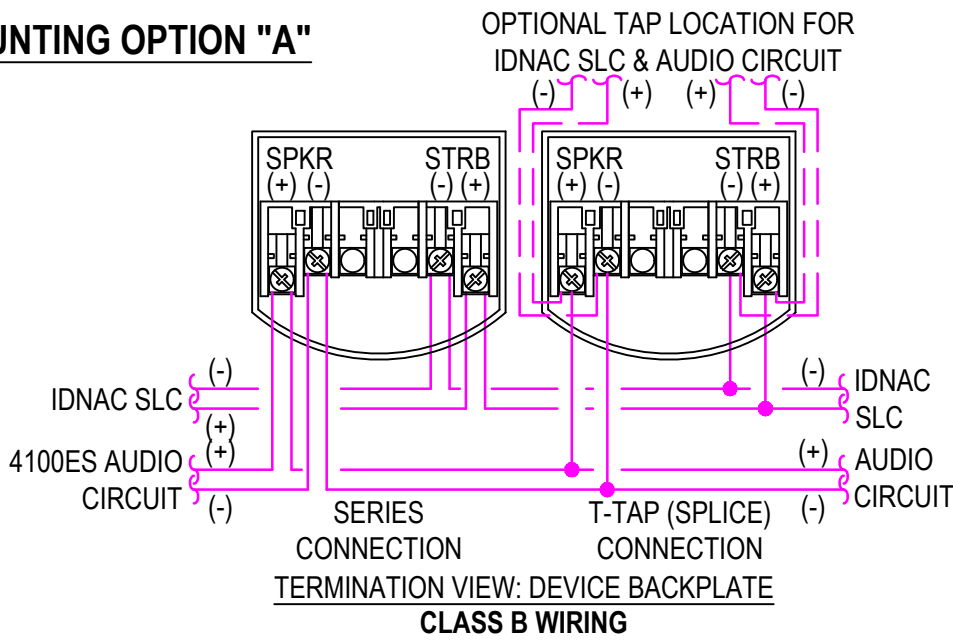

MOUNTING OPTIONS

OPTION ¹	DESCRIPTION	NOTE
A	4" (102mm) SQUARE BOX, 2-1/8" (54mm) DEEP (MIN)	BY OTHERS

1. FOR ADDITIONAL MOUNTING OPTIONS, DOWNLOAD DATA SHEET A49SOW-0001 FROM [HTTP://WWW.AUTOCALL.COM](http://www.autocall.com)



Owner

Project Name

No.	Description	Date
01	For Review	07/14/2021

Autocall_TrueAlert ES Addressable Appliances
A49SO Ceiling Mounted Speaker

Project number		01
Date	07/12/2021	
Drawn by	CV	Scale NTS
Checked by	MA	