



SENSOR BASE WITH RELAY


AUTOCALL A4098-9780

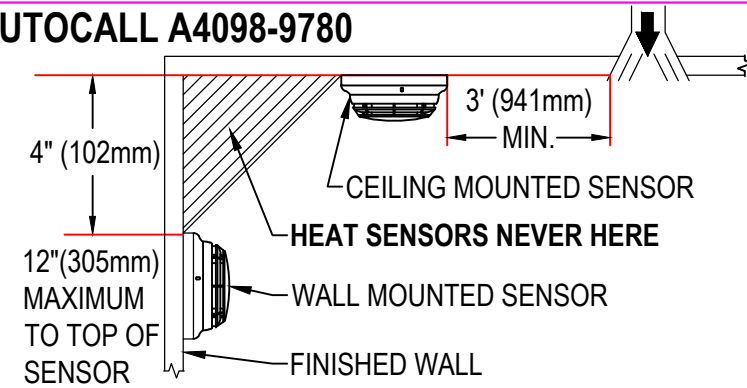

MOUNTING OPTION "A"

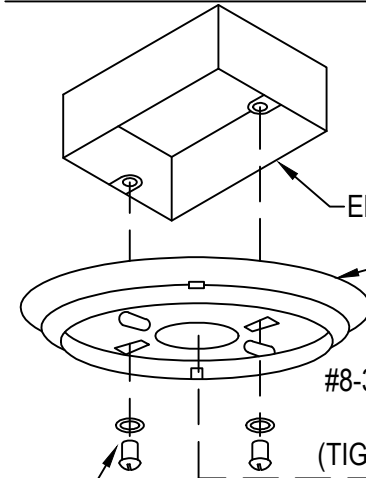


MOUNTING OPTION "B"

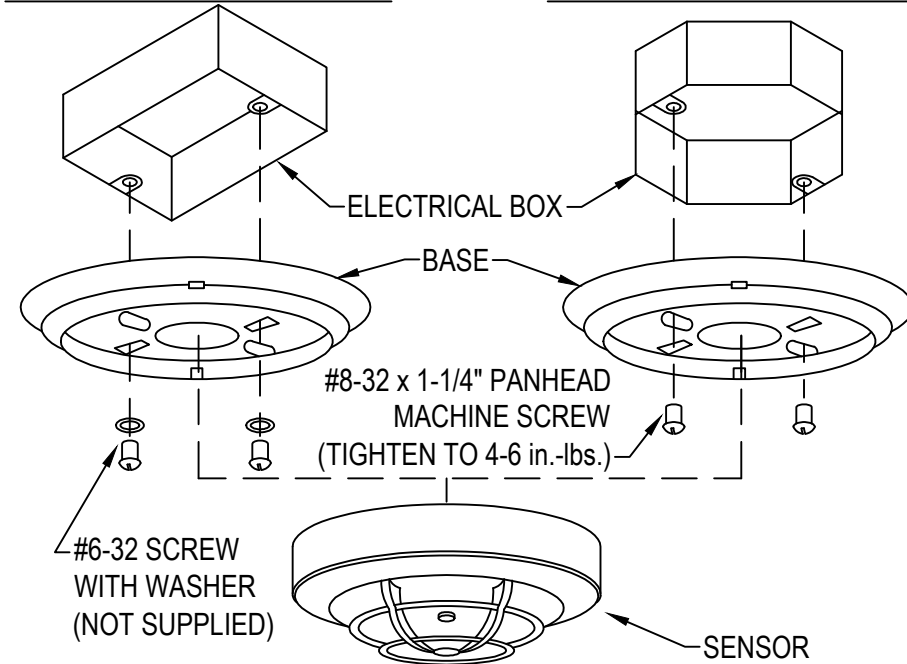

MOUNTING OPTIONS

OPTION ¹	DESCRIPTION	NOTE
A	SINGLE GANG BOX, 2-1/8" (54mm) DEEP - FLUSH MOUNT	BY OTHERS
B	4" (102mm) OCTAGONAL BOX, 1-1/2" (38mm) DEEP, MINIMUM - FLUSH MOUNT	BY OTHERS
C	4" (102mm) SQUARE BOX, 1-1/2" DEEP (MIN) W/ AUTOCALL 4098-9832 ADAPTER KIT	BOX BY OTHERS, 4098-9832 ORDERED SEPARATELY
D	4" (102mm) SQUARE BOX, 1-1/2" DEEP (MIN) W/ SINGLE GANG COVER PLATE 3/4" (19mm) EXTENSION	BY OTHERS

1. FOR ADDITIONAL MOUNTING OPTIONS, DOWNLOAD DATA SHEET A4098-0019 FROM [HTTP://WWW.AUTOCALL.COM](http://www.autocall.com)
2. SENSOR BASES WITH RELAY MODULES A2098-9737 AND A4098-9822 REQUIRE A 1.5 INCH EXTENSION RING MOUNTED TO THE 4-INCH SQUARE OR OCTAGONAL ELECTRICAL BOX (RELAY MODULE(S) CANNOT BE USED IN SINGLE-GANG ELECTRICAL BOX INSTALLATIONS) TO MEET THE SPACE REQUIREMENT OF THE RELAY CUBE AND ITS WIRES. THE RELAY MODULE A4098-9822 MUST BE INSTALLED IN THE ELECTRICAL BOX DIRECTLY.

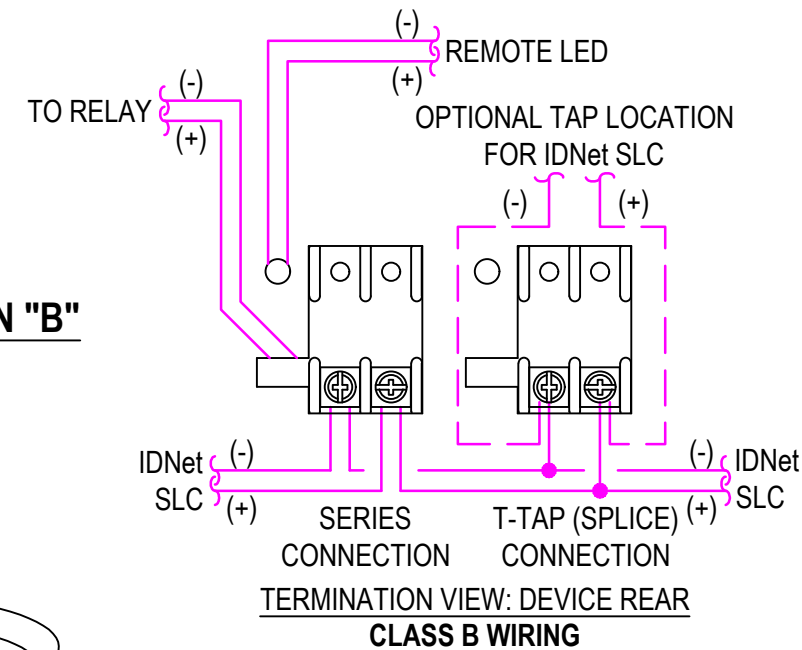

WIRING NOTES

1. MAINTAIN CORRECT POLARITY ON TERMINAL CONNECTIONS.
2. ALWAYS CUT CONDUCTORS AND SECURE UNDER TERMINALS. NEVER LOOP WIRES UNDER TERMINALS.
3. ANY WIRE SPLICES TO BE MADE BY LISTED AND AHJ APPROVED METHODS.
4. 100 FT. MAXIMUM WIRE DISTANCE FROM THE A4098-9780 BASE TO THE RELAY.



Owner

Project Name

No.	Description	Date
01	For Review	07/14/2021

Autocall_4098 Addressable Bases Detector
A4098-9780

Project number		01
Date	07/12/2021	
Drawn by	CV	Scale NTS
Checked by	MA	